

REOVIB 509

DIN rail mounted electronic control module for the control of Electromagnetic feeders



Technical Specification - REOVIB 50911

Supply Voltage	400 V, 50/60 Hz
Output Current	0.2 - 15 A
Output Frequency	Full (100 Hz) or Half (50 Hz)
Setpoint	Potentiometer, 0-10V, 0(4)-20 mA
Inhibit/Enable Input	12-24V,DC or volt-free contacts
Soft Start	Fixed 0.1 secs
Enclosure	Metal casing with screw terminals
Protection rating	IP00 - VBG 4
Ambient temp	0 - 45 degrees C
Dimensions LxWxH	74 x 112 x 150 mm

Important Features

The 509 has the following as standard







- Power ON LED
- Trimmers for Minimum and Maximum vibration
- Durable metal housing
- Full or Half wave selectable output
- Inputs for Remote ON/OFF switching
- Choice of setpoint control
- Durable housing
- Screw or Din rail fixing
- CE marked


















Special Function!

The mains supply is always fluctuating, typically between -10% and +6% this is a fact of life. Obviously feed rate is heavily dependant on the applied voltage so these changes can have a detrimental effect on the performance of automation systems.


REO controllers have inbuilt stabilisation electronics, which constantly monitor the mains input and adjust the output level accordingly ensuring that the feed rate is maintained.

Standard Rating 15 Amps. Refer to accompanying drawing when following this guide


Drawing Reference	Check Point	Connections	Important	
1	Supply Voltage 	The 509 is rated for use with a 400 V, 50/60 Hz supply Connect Live to Terminal 11 Neutral to Terminal 12 	Connect Earth connection to: Terminal 15 	Ensure unit and feeder are earthed at all times Unsure of your mains voltage? *** CHECK *** Damage will occur if incorrect
2	Feeder Connection 	The 509 is rated for use with a maximum feeder load of 15 Amps Connect L1 to Terminal 14 N1 to Terminal 13 	Connect Feeder Earth connection to: Terminal 16 	Ensure unit and feeder are earthed at all times Unsure of your feeder rating? *** CHECK *** Damage could occur if incorrect

Drawing Reference	Check Point	Options	Important			
3	Feeder Frequency 	The unit can be used on either FULL WAVE (100 Hz, 6000 cyc/min) or HALF WAVE (50 Hz, 3000 cyc/min) feeders. The unit is supplied ready for HALF WAVE operation i.e. with no link between terminals 19 and 20 	For a HALF WAVE feeder ensure that there is no connection between terminals 19 & 20 For a FULL WAVE feeder ensure that there is a LINK connection between terminals 19 & 20 	Unsure of your feeder frequency? *** CHECK *** Damage could occur if incorrect		
4	Feeder Speed 	POTENTIOMETER Connect a 10 kOhm to terminals: 5, 6 and 7 6 is the wiper 	0-10 VDC signal Connect 0 V to terminal 5 and Positive to terminal 6 	0-20 mA SIGNAL Connect (-) to terminal 5 and (+) to terminal 6 Fit link between 17 & 18 	Insert link between 17 and 18 for 0-20mA control 	Ensure that a link is fitted between terminals 1 & 2 at all times 
5	Control Range 	To allow the widest possible control range - the trimmers Umin and Umax are provided to customise the control output to each individual feeder. Adjustments can easily be made using a flat bladed terminal screw driver or pot trimmer. Step 1  Umin Turn the main control knob to 0% and adjust Umin until the feeder just begins to vibrate Step 2  Umax Turn the main control knob to 100% and adjust Umax until the feeder vibrates at the required amplitude - It may be necessary to repeat Step 1	The unit should be protected with a 20 A ULTRA FAST blow fuse on the primary side			
6 & 7	Remote Switching  <p>The remote switching facilities are usually used when the feeder needs to be regularly stopped and started automatically as part of an industrial process</p>	The feeder control unit can be remotely stopped or started by using either 1 of 2 methods:- Volt Free Contacts or 12-24VDC Control Signal CONTACTS Connect volt-free contacts between terminals 8 and 9. Open contacts to stop feeder Close contacts to start feeder 	DO NOT use switching of the mains input or the feeder supply as methods of remote control The controller could be irreparably damaged 	12-24 VDC Connect (+) to terminal 9 and connect (-) to terminal 10 Voltage ON = Unit ON Voltage OFF = Unit OFF 	The cables for connection of the control setpoint source and the inhibit input must be screened and should not be routed with the mains input or the supply to the feeder - Installation must be carried out by a competent person 	The 509 can be used in conjunction with other products in the System 500 range to provide a automated feed solution - Contact your supplier for more details


Enable override
Always fit a link!
Pins 1 & 2

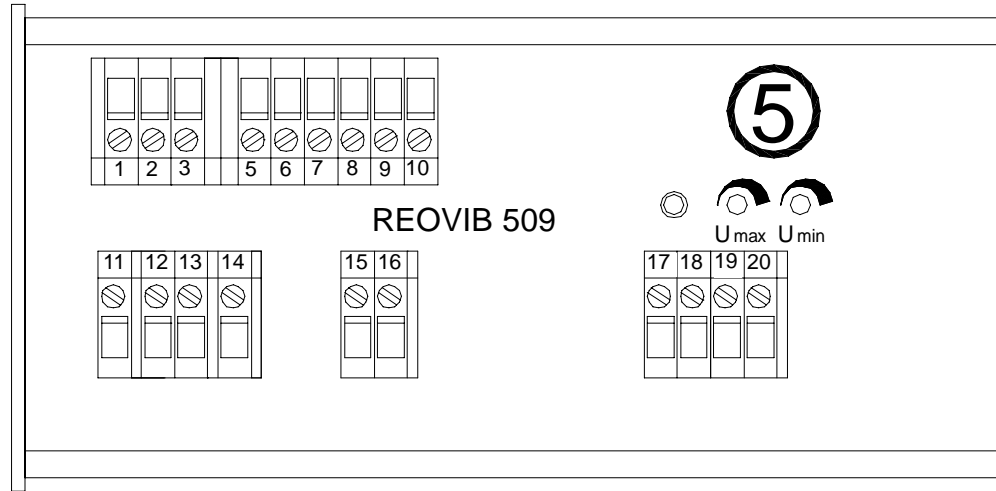


④ ⑥
0 - 20 mA 12-24 VDC
0-10 VDC

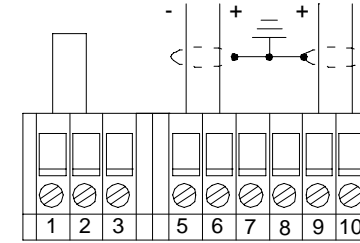

④ ⑦
10 kΩ Control Pot
Contact Enable

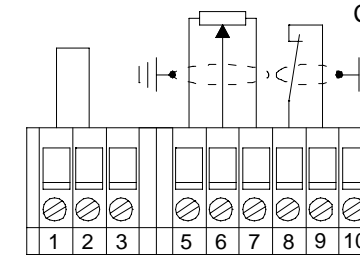

Mains Connection
400 V, 50/60 Hz

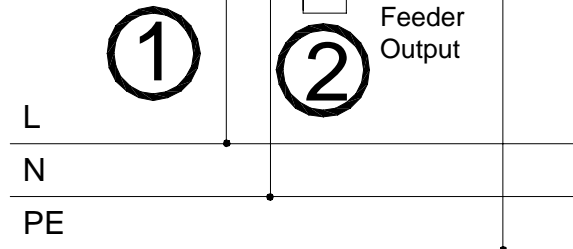

④ ③
Link for 0-20 mA
Frequency
Full/Half Wave
Link for Full Wave

Speed Control Methods:
10 kΩ Potentiometer
0-10 VDC control voltage
0-20 mA signal current

Effects of min & max trimmers

